


Assembly and Installation Instructions

9 Different Economy Models Available

TC-100, TC-150, TC-230, TC-450, TS-810, CS120, CS-350, CS575, CS1015

CS-575 includes hinged top and front louver

CS-1015 includes both front and back middle support

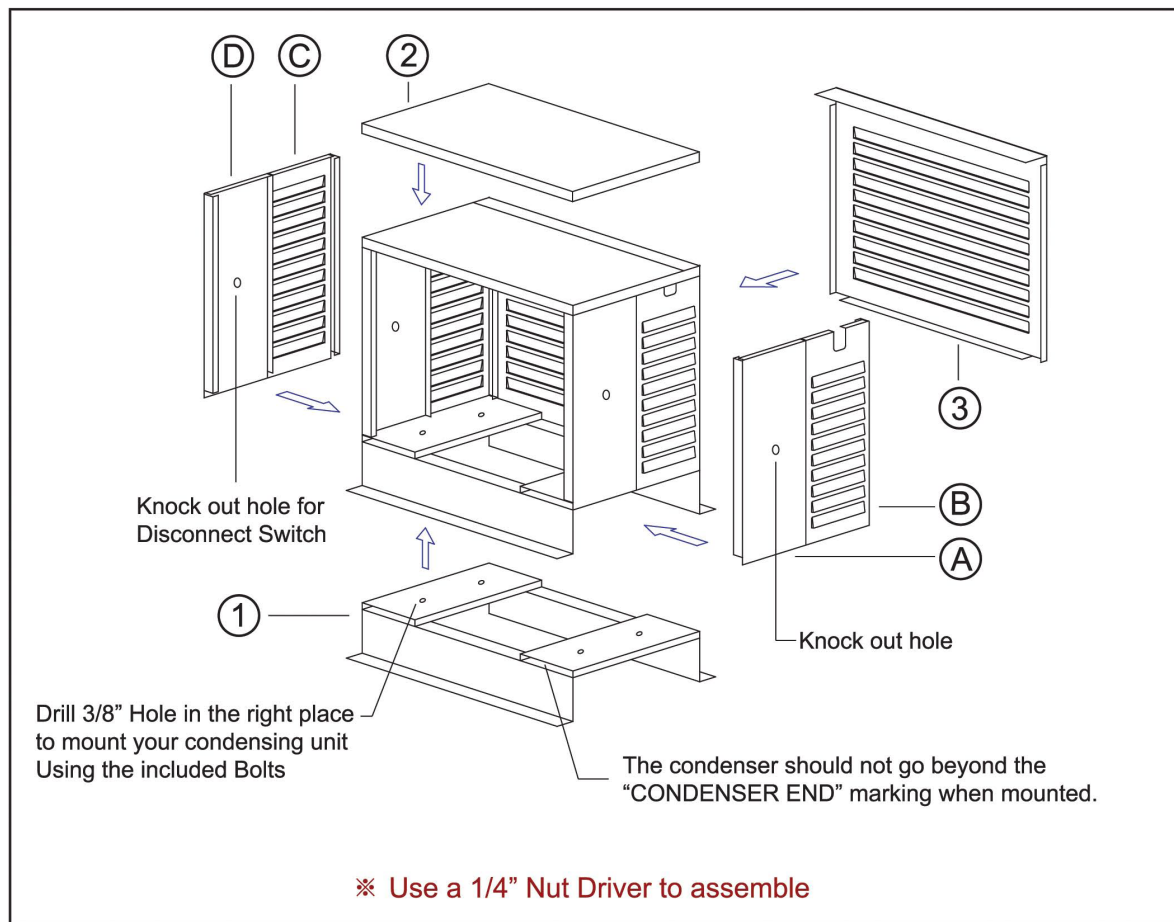

All of the information in this manual can be updated without any notice.

Steps for Assembly

- Bold badge assembly to a selected location ①
- Mounting Condensing Unit on base assemblies.
- Install side panels as shown AB, CD
- Install the top ②
- Install the hinged front louvertop ③

Field Electrical Instructions

- All field connectios are to use liquid tight conduit only.
- Field mounted disconnects are to be type MEMA3
- Field connection are to be made through the side panels via factory supplied knock-out hole only.
- All enclosure are bonded via liquid tight grounding conduit and enclosure screws
- Enclosure should be grounding according to local code requirements